


# **TR2000-DIGI**

## **Multi-Protocol Network Transmitter** BACnet® MSTP • Modbus RS485 • BACnet® IP • LonWorks® FT

## For CO, NO<sub>2</sub> and Temperature Measurement

### **Key Features**

- Intended for ventilation control in enclosed spaces with operating vehicles including parking garages, vehicle service areas, warehouses and secret underground bases.
- 4 Digital protocol options in one transmitter: BACnet® MSTP, Modbus 485, BACnet® IP and LonWorks® FT utilizing the Adesto 6050 Smart Transceiver.
- The TR2000-DIGI Transmitter can power and provide a multiprotocol digital connection for a separate and optional analog TR3210-NO2 transmitter, which must often be mounted at a different height than the CO transmitter.
- Digital outputs of the TR2000 DIGI include carbon monoxide. temperature and NO2 from a remotely mounted AirTest TR3210-NO2.
- Utilizes a single gang, 4" X 3" X 2.5" electrical box (included), identical to original TR2000 design.
- CO sensing element is certified to UL2075. •
- Selectable baud rate adjustment. •
- Calibration pots for zero and span calibration.
- Replacement factory-calibrated assembly available. •
- Enclosure, appearance and calibration identical to the TR2000 • transmitter.

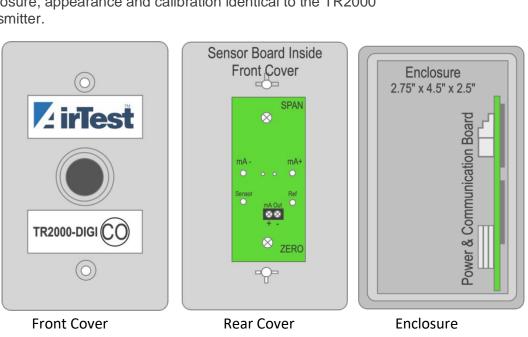




sales@AirTest.com

P: 604 517-3888

### **Dimensions and Wiring**

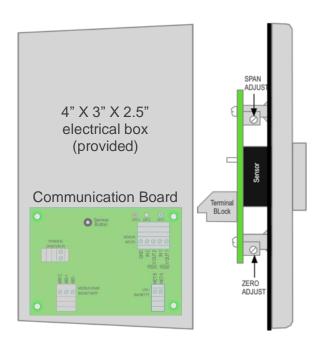

Side View

#### Power and Communication Board

(Board is removed from enclosure for wiring)

- 1. 24 VAC Power In
- 2. BACnet® MSTP, Modbus 485 out
- 3. Sensor Inputs for CO and NO2 (4-20 mA loop powered) using
- 4. FT Lon or BACnet<sup>®</sup> IP out


## Specifications

#### General

Measurement: CO, Temperature Temp Operating Conditions: -4 to 122° F (-20 to 50°C) Temp Storage Conditions: -40 to 158°F (-40 to 70°C) RH Operating Conditions: 0 to 90% RH **CO** Measurement Sensing Method: Electrochemical Approval: UL2075 Certified Sensor Measurement Range: 0-200 ppm Sensor Rated Life: 6 years Annual Drift: +/- 5% of measured value Response Time: T90 = <1 minute (diffusion) Warm Up Time: < 2 minutes EnclosureTemperature: Method: Thermistor Measurement Range: -4 to 122° F (-20 to 50°C) Accuracy: ±2.6 °F (±2°C) Power/Wiring Voltage: 24VAC ±20%, full wave rectified Power Consumption: 50 mA max Power Wiring: 18 gauge or larger depending on wire run length BACnet® MSTP/Modbus RS485 Communication ! Isolated RS485 connection! ! Must use 3-wire connection! Wiring: Impendence Options RS485 Rated (120 Ohms characteristic impendence 1. terminated with 120 Ohm resisters at each end) or, 2. CAT5 (100 Ohms characteristic impendence terminated with 100 Ohm resister at each end). Use one in-cable twisted pairs for RS485 + and RS485 -. Use single wire from a twisted pair for common. Baud Rate: Adjustable using DIP Switch 2 on Communication Board TR2000-DIGI LON XIF File Link: www.Airtest.com/sw/AT2K\_060.XIF TR3210-NO2 Integration

The TR2000-DIGI provides a two-wire connection to the loop powered TR3210-NO2 that allows the sensor to be mounted nearby at a height suitable for local codes requirements. Datasheet: www.AirTest.com/ds/TR3210.pdf


0 Service Button 3 SENSOR 1 POWER IN 00000 INPUTS DC IN 0 z Z 50 5 0 R3210 TR2000 Ū Щ 2 MODBUS RS485 LON/ 000 00 BACNET MSTE BACNET FT  $\bigcirc$ 

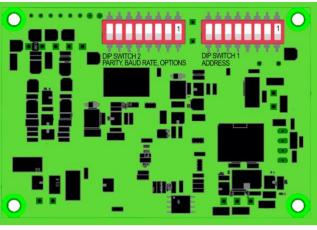



Specifications subject to change without notice

## Connecting the TR3210-NO2 Transmitter to the TR2000-DIGI

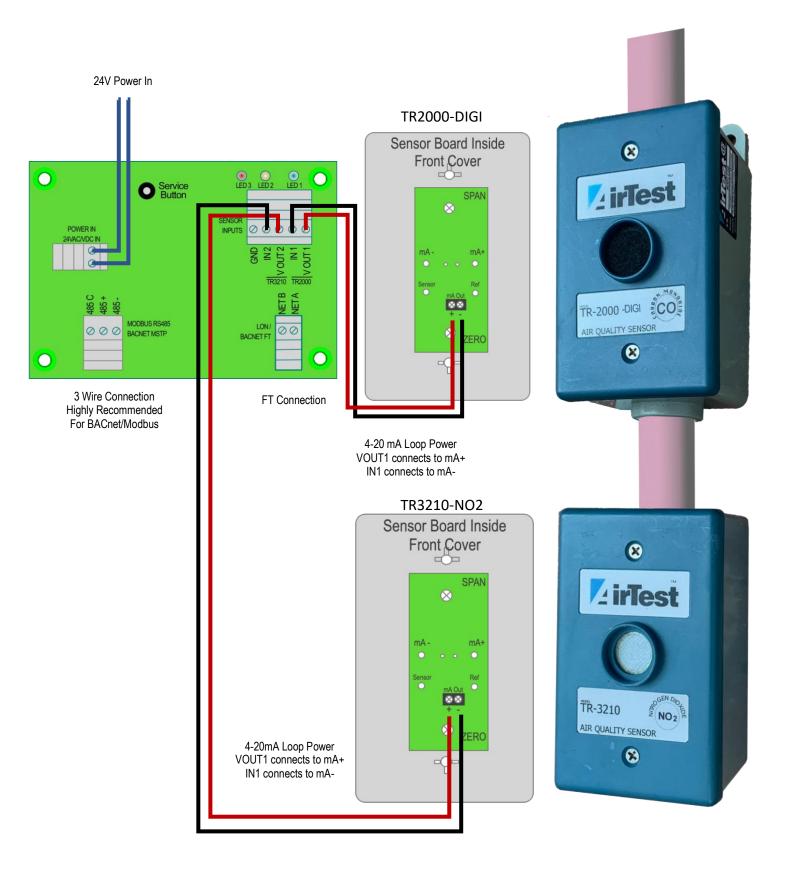

AirTest Technologies Inc.

#### **Network Connection Data**

Lon Network Variables	Description	Bacnet Objects
LONWORKS NETWORK OUTPUTS / BACNET INPUT OBJECTS		
SNVT_temp_nvoTempP	Temperature: Temperature output reported by on board temp sensor. This sensor is offset by nciTempOffssetP to read closer to ambient when powered from 24 VDC.	Temp In C Temp In F
SNVT_count nvoSw1	S1 Address Dip Switchs: 0 is all off This is the MSTP address and 1-127 is valid. A value of 0 tells the firmware not to use the switches. As shipped, the default address is 47 with all switches off. S1 position 8 is ignored.	n/a
SNVT_count nvoSw2	<b>S2 Baud Dip Switches.</b> Position 2 and 1 set the baud as follows Off,Off = 38400, Off,On = 19200, On,Off = 9600, On,On = 4800 As shipped, both positions are off which sets the baud to 38400.	n/a
SNVT_count nvoSwFactory	Factory Jumpers FJ1 to FJ4. Those are all installed by default. They are not be field changeable and not currently used.	n/a
SNVT_lev_percent nvoAI[2]	Percent Reading: Array of two percentage output values that represent the analog input with 0% being 4 ma and 100% being 20 mA. Values below 3.5 mA and above 22.5 mA are considered errors. Values above 3.5 mA but below 4 ma is considered 0%. Errors will be reported as 163.835% which is highest percentage represented. You will see this if nothing is connected. A valid input will cause green led to be on. A value below 3.5 ma will cause green led to be off. A value higher than 22.5 ma is considered a wiring fault and will cause red led to fast flash.	Percent 1 Percent 2
SNVT_ppm_f nvoPpmF[2]	PPM Reading: Array of two floating point output values that represent ppm as scaled using nciPpmMaxF[2]. A floating point NAN will be returned if the inputs are invalid as described above.	PPM 1 PPM 2
CONFIGURATION INPUT N	IETWORK VARIABLES / BACNET OUTPUT OBJEC	CTS
SNVT_temp_diff_p nciTempOffsetP	Temp Offset: Default is -7.5 C which is offset temperature between what the on- board temp sensor is reading and an estimate of ambient temperature outside enclosure. This offset affects nvoTempP.	Temp Offset C
SNVT_lev_percent nciAIMinDelta[2]	Analog input delta for throttling network updates of nvoAI[] and nvoPPMF[]. Defaults to 1 percent.	n/a
SNVT_time_sec nciMinSendT	Minimum send time for Analog inputs and temperature for LON bound output network variable transmission throttling. Defaults to 1 second	n/a
SNVT_time_sec nciMaxSendT	Maximum send time for analog inputs and temperature for LON bound output network variable transmission throttling. Defaults to 15 seconds	n/a
SNVT_count neiDaysToCal[2]	Days to Calibrate: Array of two non-volatile input values that indicate number of days to calibrate. Initialized to 1825 for the first which is 5 years and 725 for the second which is 2 years for the second channel. They will decrement once per day. They do not keep track of partial days so if you leave the power off, you will lose days. These are user configurable and saved to non volatile memory. They do not decrement if the input is invalid.	Days To Cal 1 Days to Cal 2
SNVT_ppm_f nciPpmMax[2]	Maximum Gas Values: An array of two input variables that control the maximum PPM for each channel. Initialized for 200 for CO and 10 for NO2. You can set these anywhere you want via Lon and Bacnet. These are user configurable and saved to non volatile memory.	Max PPM 1 Max PPM 2
SNVT_count nciCalWarnDays[2]	Days To Cal Warning: Defaults to 45 days for each of the inputs. If non-zero will start to flash the associated green led for that input to indicate that neiDaysToCal[] is about to become due in less than 45 days in this case. Once neiDaysToCal[] goes to 0, it will fast flash the green led. To disable this warning simply set nciCalWarnDays[] to 0.	